


WHEN THE CURB BOX FALLS IN THE DRIVEWAY A DRIVEWAY CASTING MUST BE USED, NEENAH R-1791-A, AY MCDONALD 74M32A, OR APPROVED EQUAL.

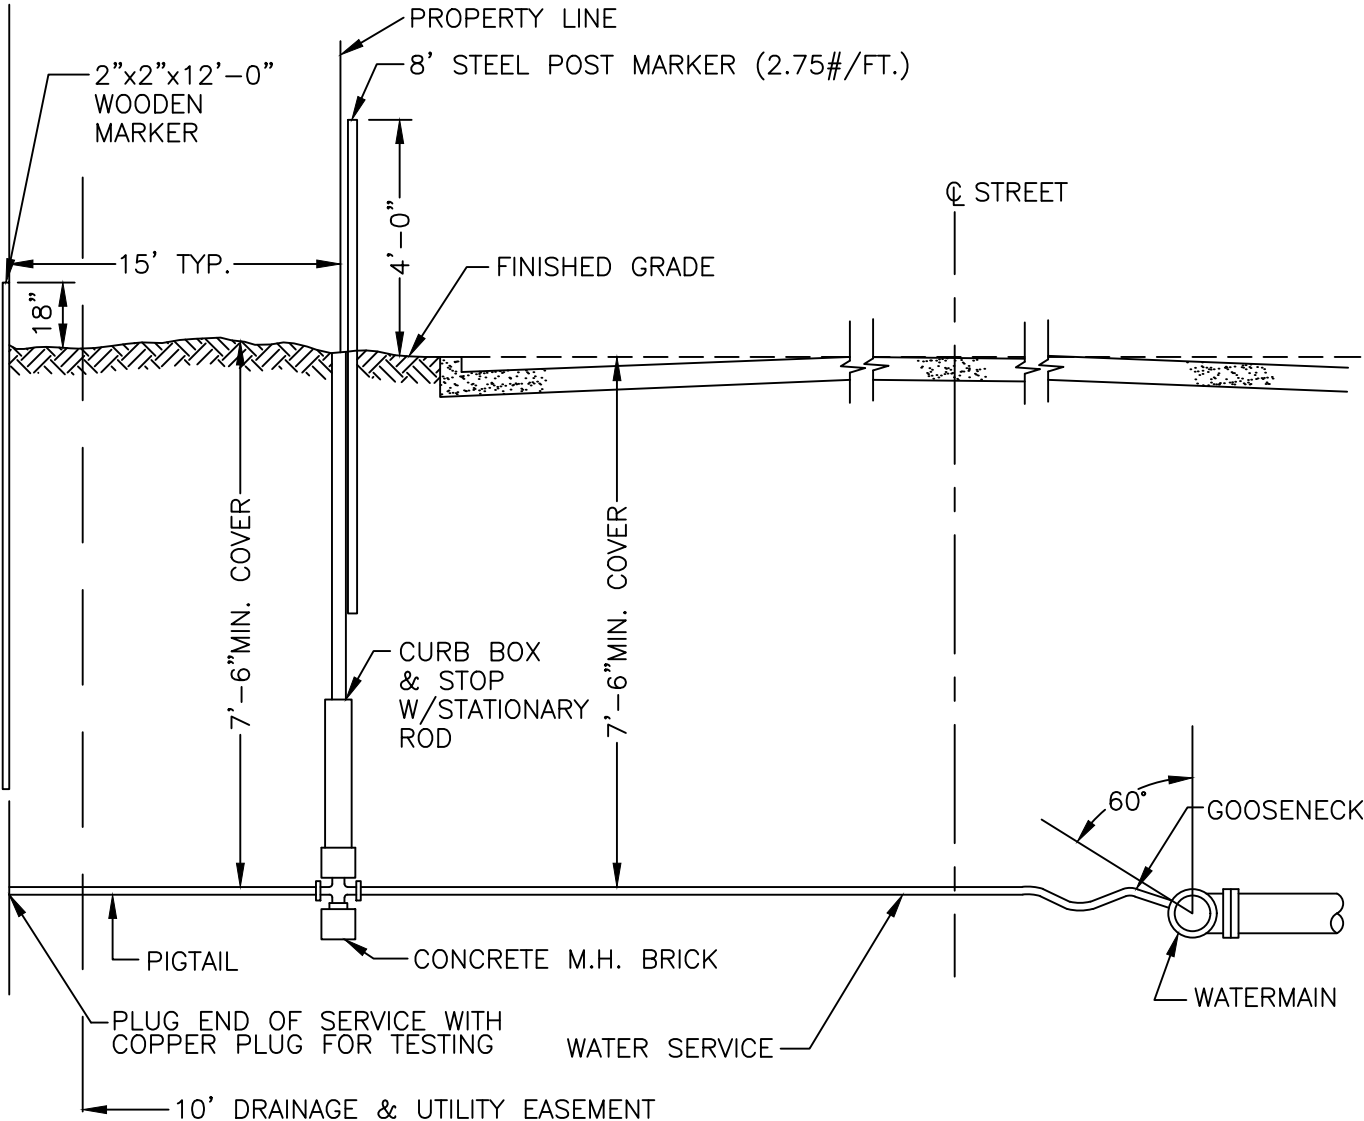

NOTE:
 SERVICE TAP TO BE MADE SLIGHTLY ABOVE SPRING LINE
 SO THAT COPPER LOOP SHALL NOT EXTEND ABOVE MAIN.
 MAINTAIN 7'-6" MINIMUM COVER FOR ALL SERVICE LINES.
 SADDLES SHALL BE USED FOR ALL CONNECTIONS TO
 6" OR SMALLER DIAMETER WATERMAINS AND ALL P.V.C
 WATERMAIN CONNECTIONS.

NOTE: SEE STANDARD PLATE LV-ST-11
 FOR MnOPS REQUIREMENTS
 RELATED TO FUTURE LOCATING.

	WATERMAIN	PLATE NO. <u>LV-WM-2</u>
	WATER SERVICE CONNECTION	DATE <u>02/2024</u>