


STAPLE DENSITY SHALL BE A MINIMUM OF 3 U-SHAPED 8", 11 GAUGE METAL STAPLES PER SQUARE YARD, 6" E-STAPLE OR APPROVED EQUAL AS DESIGNATED ON THE PLANS (THIS MAY VARY PER MANUFACTURER OR AS REQUIRED ON THE PLANS.)

ANCHOR TRENCH

1. DIG 6" X 6" TRENCH
2. LAY BLANKET IN TRENCH
3. STAPLE AT 1.5' INTERVALS OR AS DIRECTED ON THE PLANS
4. BACKFILL WITH NATURAL SOIL AND COMPACT
5. ANCHOR TRENCHES SHALL BE PLACED AT THE TOP OF SLOPE, AND EVERY 100 LINEAR FEET OF SLOPE

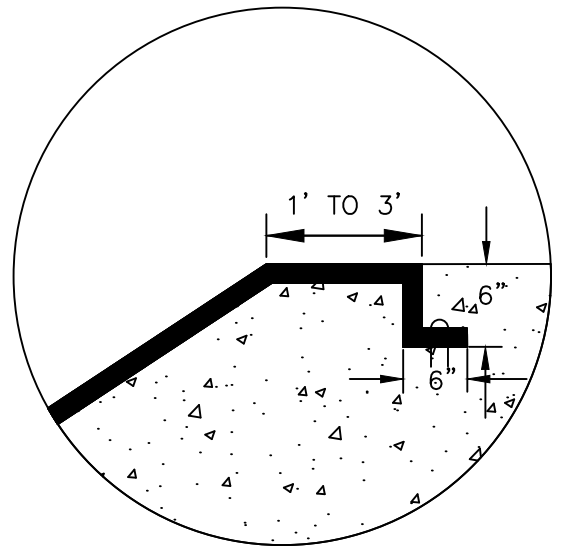

EROSION CONTROL
BLANKET INSTALLATION

PLATE NO. LV-STM-19

DATE 02/2024